



Requires the installation of a :

Gateway module




OR

Connected Starter Pack  
"... with Netatmo"



### Composition

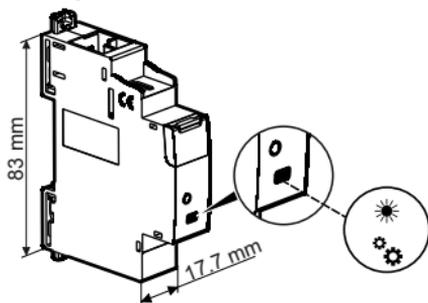

Connected energy meter

+



⚠ Pay attention to the direction of the current  
Measure coil

	<b>U</b>	<b>I</b> measure	<b>F</b>	Accuracy  kWh	Measure  kWh
+5°C +45°C	100-240V~ 50 / 60Hz	80A MAX	2,4 à 2,4835Ghz <100 mW	+/-1% under 63A	Global & Per* circuit

CE Directive  
Compliant with the following European directive:

Low voltage directive  
(LVD) 2014/35/UE

Electromagnetic compatibility  
(CEM) n° 2014/30/UE

\*Functionality available only if several connected energy meters are installed.

### Imperative security precaution




Failure to strictly comply with the installation and use conditions may result in risk of electric shock or fire.


# 1 Preparation, connexion




Turn off the power at general circuit breaker

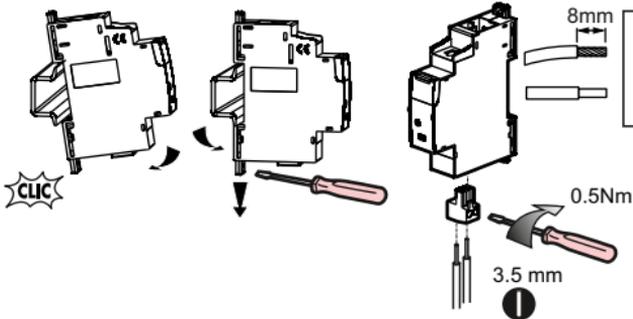

## Wiring

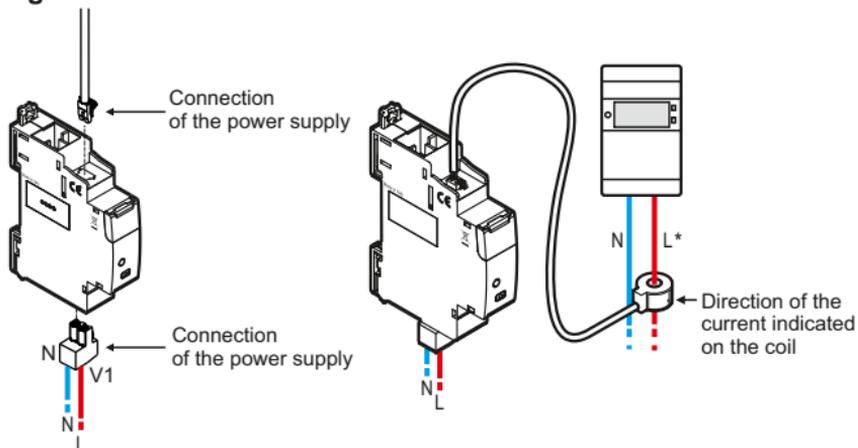




A circuit breaker for the Energy meter is necessary

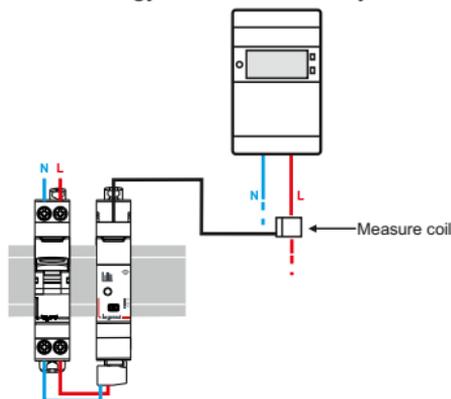


\*: Do not use on a three Lines electrical installation.

— N (neutral) = blue      — L (Line) = Everything but blue and green/yellow

**2** Add the **Energy meter** in a connected installation




**3** Press and hold the Gateway module settings button, or in the center of the General Scenario Wireless Command until the LED turns green, then release the button.

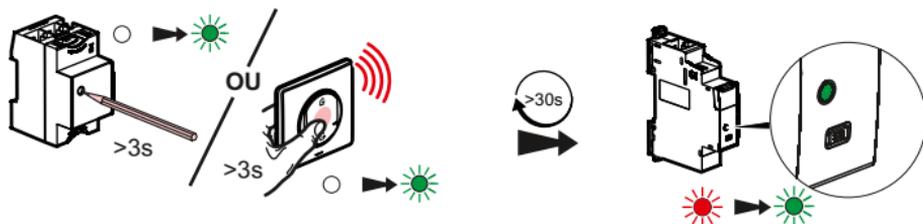

The configuration LEDs of " ... with Netatmo " devices must all light up in fixed green.

**4** Complete the installation

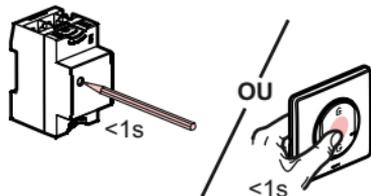

**Briefly press** the setting button on the Gateway module (or in the center of the General Scenario Wireless Command) to finalize the installation. All devices LED go OFF.

**5** Finalize the installation in the Legrand Home + Control app

To add this connected product and peripheral items in your connected installation, you must follow the instructions:

- with Legrand Home + Control app


(Parameters/Add new product)

- or consult the guides and instructions sheets on **legrand.fr**



## Reset an Energy meter to remove it from a connected installation

Press the button for more than 5 seconds  
configuration of the Energy meter until  
the configuration indicator lights up solid red.  
It is no longer associated with the Gateway module  
/ Control socket.

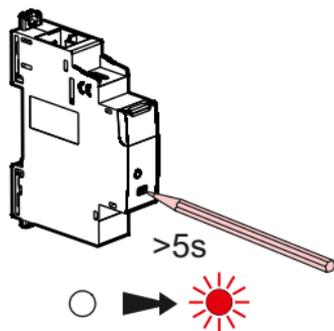

[www.legrand.fr/reference/412015](http://www.legrand.fr/reference/412015)

LEGRAND - Pro and Consumer Service - BP 30076  
87002 LIMOGES CEDEX FRANCE • [www.legrand.com](http://www.legrand.com)

## EU SIMPLIFIED DECLARATION OF CONFORMITY

The undersigned,

**Legrand**

declares that the radio equipment listed on this instruction sheet  
are compliant to the directive 2014/53/UE.

The full text of the EU declaration of conformity  
is available at the following website:

[www.legrandoc.com](http://www.legrandoc.com)